

Coleman Creek Consulting, Inc.

DRINKING WATER LEAD SAMPLING
OF
BRIXNER JR. HIGH SCHOOL
4727 HOMEDALE ROAD, KLAMATH FALLS, OREGON
FOR
KLAMATH COUNTY SCHOOL DISTRICT

INTRODUCTION


Coleman Creek Consulting, Inc. (CCC) was retained by Klamath County School District (KCS D) to perform representative lead drinking water sampling of Brixner Jr. High School (Brixner) at the above address. The purpose of the lead drinking water sampling was to determine the concentration of lead in representative drinking water sources and compare with regulatory standards. In 2017, Education Service Districts were required to adopt a Healthy and Safe Schools Plan, including provisions for testing and reducing exposure to elevated levels of lead in water used for drinking and food preparation.

LEAD DRINKING WATER SAMPLING REQUIREMENTS

Guidelines for sampling lead in water were established by the Oregon Health Authority. Water sampling is to occur after water sits overnight in the pipes without being used, and must be sampled after a day occupied by students or building occupants. All water sources are to be sampled, with the exception of water used for heating, sanitation, irrigation, and science sinks for grades 6 and up with non-potable water signs. Initial testing is required to be performed by 2020, and every 6 years thereafter, according to a testing schedule determined by the Oregon Department of Education.

SAMPLE LOCATION DETERMINATION/SAMPLE PREP

David W. Fawcett of CCC contacted Kim Pine, Head Custodian at Brixner, and discussed the objectives of the lead drinking water program. Mr. Pine reviewed the School building for water sources and identified by type on a building floor plan. Mr. Fawcett and Mr. Pine discussed the drinking water sources by phone, and Mr. Fawcett created a Site Sample Record Sheet describing each drinking water source by type and location. Mr. Fawcett identified each source by number (B1-B57), and identified each source number on a floor plan diagram of the school building. Mr. Fawcett delivered the following sampling materials to Mr. Pine March 10, 2022: Numbered sample containers, Site Sample Record Sheet filled out with Sample Number, Sample Type, and Location. Mr. Pine was instructed in proper sampling technique, including sampling prior to water system use by other school occupants, fill sample container immediately from faucet opening, and recording time of water sampling on the Site Sample Record Sheets (pages 3-5).



Coleman Creek Consulting, Inc.

DRINKING WATER SAMPLING

Mr. Pine collected lead drinking water samples from the drinking water sources identified in Brixner Jr. High School March 11, 2022. See Site Sample Record Sheets (pages 3-5) for a description of the drinking water sources sampled. See Drinking Water Sample Location Diagram in Appendix A for a visual review of all drinking water sample locations. The drinking water samples were collected in the early morning, ensuring that the sample source had not been in use since the previous day. The samples were placed in a cooler. Mr. Fawcett picked up the samples collected by Mr. Pine March 11, 2022, and transported to Neilson Research Corporation in Medford, Oregon.

DRINKING WATER LEAD RESULTS AND TESTING SUMMARY SHEETS

The fifty-seven drinking water samples collected were analyzed for lead using EPA Method 200.8. See Neilson Research Corporation Analytical Report in Appendix B. Drinking Water Testing Summary Sheets (pages 6-8) indicate the lead in drinking water concentrations for the fifty-seven (57) samples collected from the Main School Building and Shop Building were reported ranging from <0.515 to 10.3 parts per billion (ppb).


CONCLUSIONS

Fifty-seven (57) drinking water samples were collected from drinking water sources at the Brixner Jr. High School Building and Shop Building prior to use that day by building occupants, and after a day the facility was occupied. The lead concentrations reported were all below the 15 ppb lead action level in water.

RECOMMENDATIONS

Coleman Creek Consulting, Inc. recommends future drinking water sampling at Brixner Jr. High School according to the schedule set out by the Oregon Department of Education. Coleman Creek Consulting, Inc. appreciates the opportunity to continue to perform environmental sampling and consulting services to Klamath County School District.

David W. Fawcett
Director of Consulting Services



Coleman Creek Consulting, Inc.


DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Brixner Jr. High School
ADDRESS: 4727 Homedale Road
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Kim Pine

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.B1	DW	Hall Fountain at Room 3	0630
22-010G.B2	DW	Library South Faucet	0631
22-010G.B3	DW	Library North Faucet	0632
22-010G.B4	DW	Hall Fountain at Room 12	0635
22-010G.B5	DW	Girl's Hall RR at Conference Room L Faucet	0640
22-010G.B6	DW	Girl's Hall RR at Conference Room M Faucet	0640
22-010G.B7	DW	Girl's Hall RR at Conference Room R Faucet	0640
22-010G.B8	DW	Boy's Hall RR at Conference Room L Faucet	0642
22-010G.B9	DW	Boy's Hall RR at Conference Room M Faucet	0642
22-010G.B10	DW	Boy's Hall RR at Conference Room R Faucet	0642
22-010G.B11	DW	Staff Lounge Faucet	0645
22-010G.B12	DW	Office Men's RR Faucet	0646
22-010G.B13	DW	Office Women's RR Faucet	0646
22-010G.B14	DW	Office Sink Faucet Next to Women's RR	0646
22-010G.B15	DW	Room 14 L Faucet	0650
22-010G.B16	DW	Room 14 LM Faucet	0650
22-010G.B17	DW	Room 14 RM Faucet	0650
22-010G.B18	DW	Room 14 R Faucet	0651
22-010G.B19	DW	Cafeteria Fountain at Room 14	0652
22-010G.B20	DW	Room 15 L Faucet	0654

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



Coleman Creek Consulting, Inc.


DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Brixner Jr. High School
ADDRESS: 4727 Homedale Road
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Kim Pine

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.B21	DW	Room 15 LM Faucet	0654
22-010G.B22	DW	Room 15 RM Faucet	0654
22-010G.B23	DW	Room 15 R Faucet	0654
22-010G.B24	DW	Room 16 L Faucet	0655
22-010G.B25	DW	Room 16 LM Faucet	0655
22-010G.B26	DW	Room 16 LMM Faucet	0655
22-010G.B27	DW	Room 16 RMM Faucet	0658
22-010G.B28	DW	Room 16 RM Faucet	0658
22-010G.B29	DW	Room 16 R Faucet	0658
22-010G.B30	DW	Room 17 SPED Faucet	0700
22-010G.B31	DW	Room 17 RR Faucet	0700
22-010G.B32	DW	Cafeteria Fountain at Room 17	0702
22-010G.B33	DW	Boy's PEN RR L Faucet	0705
22-010G.B34	DW	Boy's PEN RR M Faucet	0705
22-010G.B35	DW	Boy's PEN RR R Faucet	0705
22-010G.B36	DW	Girl's PEN RR L Faucet	0707
22-010G.B37	DW	Girl's PEN RR M Faucet	0707
22-010G.B38	DW	Girl's PEN RR R Faucet	0707
22-010G.B39	DW	Kitchen Sink Faucet Facing Walk-in	0709
22-010G.B40	DW	Kitchen Double Sink Faucet	0709

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



Coleman Creek Consulting, Inc.


DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Brixner Jr. High School
ADDRESS: 4727 Homedale Road
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Kim Pine

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
22-010G.B41	DW	Room 18 Fountain	0720
22-010G.B42	DW	Girl's Locker Outside Office Faucet	0722
22-010G.B43	DW	Gym Fountain at Girl's Locker	0722
22-010G.B44	DW	Girl's Locker L Faucet	0722
22-010G.B45	DW	Girl's Locker R Faucet	0723
22-010G.B46	DW	Boy's Locker Outside Office Faucet	0725
22-010G.B47	DW	Boy's Locker L Faucet	0726
22-010G.B48	DW	Boy's Locker R Faucet	0726
22-010G.B49	DW	Shop Building RR Faucet	0735
22-010G.B50	DW	Shop Building L Faucet	0735
22-010G.B51	DW	Shop Building LM Faucet	0736
22-010G.B52	DW	Shop Building RM Faucet	0736
22-010G.B53	DW	Shop Building R Faucet	0737
22-010G.B54	DW	Boiler Room RR Faucet	0742
22-010G.B55	DW	Room 19 L Sink	0745
22-010G.B56	DW	Room 19 M Sink	0745
22-010G.B57	DW	Room 19 R Sink	0746

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



Coleman Creek Consulting, Inc.


DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District
DISTRICT ID#: 467
SCHOOL NAME: Brixner Jr. High School
BUILDING NAME: Brixner Jr. High School
BUILDING ID#: 20571300

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.B1	Hall Fountain at Room 3	20571300-001DW	03-11-22	<0.515		
22-010G.B2	Library South Faucet	20571300-002SF	03-11-22	8.14		
22-010G.B3	Library North Faucet	20571300-003SF	03-11-22	0.909		
22-010G.B4	Hall Fountain at Room 12	20571300-004DW	03-11-22	0.705		
22-010G.B5	Girl's RR at Conf. Room L Faucet	20571300-005BF	03-11-22	0.629		
22-010G.B6	Girl's RR at Conf. Room M Faucet	20571300-006BF	03-11-22	<0.515		
22-010G.B7	Girl's RR at Conf. Room R Faucet	20571300-007BF	03-11-22	<0.515		
22-010G.B8	Boy's RR at Conf. Room L Faucet	20571300-008BF	03-11-22	<0.515		
22-010G.B9	Boy's RR at Conf. Room M Faucet	20571300-009BF	03-11-22	<0.515		
22-010G.B10	Boy's RR at Conf. Room R Faucet	20571300-010BF	03-11-22	<0.515		
22-010G.B11	Staff Lounge Faucet	20571300-011SF	03-11-22	<0.515		
22-010G.B12	Office Men's RR Faucet	20571300-012BF	03-11-22	0.547		
22-010G.B13	Office Women's RR Faucet	20571300-013BF	03-11-22	<0.515		
22-010G.B14	Office Sink Faucet at Women's RR	20571300-014SF	03-11-22	4.34		
22-010G.B15	Room 14 L Faucet	20571300-015CF	03-11-22	6.25		
22-010G.B16	Room 14 LM Faucet	20571300-016CF	03-11-22	3.16		
22-010G.B17	Room 14 RM Faucet	20571300-017CF	03-11-22	10.3		
22-010G.B18	Room 14 R Faucet	20571300-018CF	03-11-22	4.67		
22-010G.B19	Cafeteria Fountain at Room 14	20571300-019DW	03-11-22	1.59		
22-010G.B20	Room 15 L Faucet	20571300-020CF	03-11-22	0.661		
22-010G.B21	Room 15 LM Faucet	20571300-021CF	03-11-22	1.06		
22-010G.B22	Room 15 RM Faucet	20571300-022CF	03-11-22	7.82		
22-010G.B23	Room 15 R Faucet	20571300-023CF	03-11-22	0.961		
22-010G.B24	Room 16 L Faucet	20571300-024CF	03-11-22	0.615		
22-010G.B25	Room 16 LM Faucet	20571300-025CF	03-11-22	0.595		
22-010G.B26	Room 16 LMM Faucet	20571300-026CF	03-11-22	1.43		
22-010G.B27	Room 16 RMM Faucet	20571300-027CF	03-11-22	0.893		
22-010G.B28	Room 16 RM Faucet	20571300-028CF	03-11-22	<0.515		
22-010G.B29	Room 16 R Faucet	20571300-029CF	03-11-22	<0.515		
22-010G.B30	Room 17 SPED Faucet	20571300-030CF	03-11-22	<0.515		
22-010G.B31	Room 17 RR Faucet	20571300-031CF	03-11-22	<0.515		
22-010G.B32	Cafeteria Fountain at Room 17	20571300-032DW	03-11-22	<0.515		

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler
CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet
KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



Coleman Creek Consulting, Inc.


DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District
DISTRICT ID#: 467
SCHOOL NAME: Brixner Jr. High School
BUILDING NAME: Brixner Jr. High School
BUILDING ID#: 20571300

Sample Number	Fixture Location Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.B33	Boy's PEN RR L Faucet	20571300-033BF	03-11-22	<0.515		
22-010G.B34	Boy's PEN RR M Faucet	20571300-034BF	03-11-22	<0.515		
22-010G.B35	Boy's PEN RR R Faucet	20571300-035BF	03-11-22	<0.515		
22-010G.B36	Girl's PEN RR L Faucet	20571300-036BF	03-11-22	<0.515		
22-010G.B37	Girl's PEN RR M Faucet	20571300-037BF	03-11-22	<0.515		
22-010G.B38	Girl's PEN RR R Faucet	20571300-038BF	03-11-22	<0.515		
22-010G.B39	Kitchen Sink Faucet at Walk-in	20571300-039KF	03-11-22	<0.515		
22-010G.B40	Kitchen Double Sink Faucet	20571300-049KF	03-11-22	2.01		
22-010G.B41	Room 18 Fountain	20571300-041DW	03-11-22	1.24		
22-010G.B42	Girl's Locker Outside Office Faucet	20571300-042SF	03-11-22	<0.515		
22-010G.B43	Gym Fountain at Girl's Locker	20571300-043DW	03-11-22	4.15		
22-010G.B44	Girl's Locker L Faucet	20571300-044BF	03-11-22	<0.515		
22-010G.B45	Girl's Locker R Faucet	20571300-045BF	03-11-22	<0.515		
22-010G.B46	Boy's Locker Outside Office Faucet	20571300-046BF	03-11-22	<0.515		
22-010G.B47	Boy's Locker L Faucet	20571300-047BF	03-11-22	<0.515		
22-010G.B48	Boy's Locker R Faucet	20571300-048BF	03-11-22	<0.515		
22-010G.B54	Boiler Room RR Faucet	20571300-054SF	03-11-22	<0.515		
22-010G.B55	Room 19 L Sink	20571300-055CF	03-11-22	0.520		
22-010G.B56	Room 19 M Sink	20571300-056CF	03-11-22	<0.515		
22-010G.B57	Room 19 R Sink	20571300-057CF	03-11-22	4.99		

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler
CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet
KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



Coleman Creek Consulting, Inc.

DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District
DISTRICT ID#: 467
SCHOOL NAME: Brixner Jr. High School
BUILDING NAME: Shop
BUILDING ID#: 20571303

Sample Number	Fixture Location Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
22-010G.B49	Shop Building RR Faucet	20571300-049BF	03-11-22	<0.515		
22-010G.B50	Shop Building L Faucet	20571300-050CF	03-11-22	<0.515		
22-010G.B51	Shop Building LM Faucet	20571300-051CF	03-11-22	0.892		
22-010G.B52	Shop Building RM Faucet	20571300-052CF	03-11-22	5.19		
22-010G.B53	Shop Building R Faucet	20571300-053CF	03-11-22	<0.515		

Fixture ID Coding:

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler
CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet
KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)


APPENDIX A

**DRINKING WATER SAMPLE LOCATION
DIAGRAM**


BRIXNER JUNIOR HIGH SCHOOL

Drinking Water Sample Locations

SCHOOL BUILDING

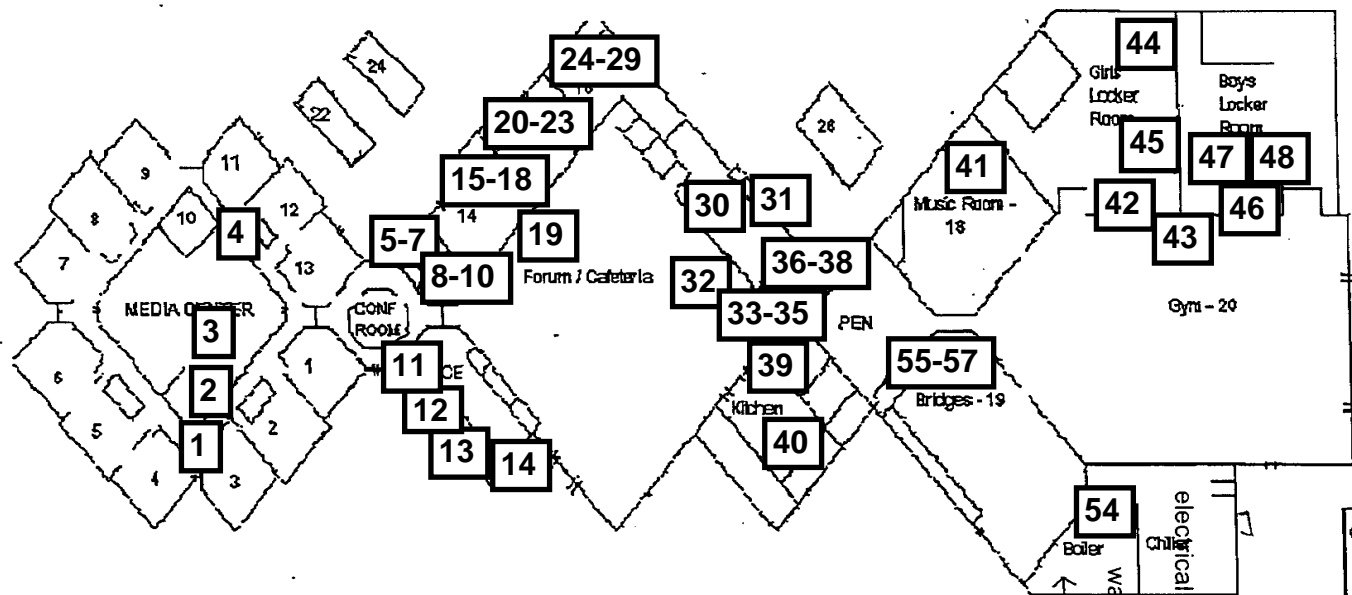

12 = Drinking Water Sample Location



SHOP BUILDING

APPENDIX B

NEILSON RESEARCH CORPORATION ANALYTICAL REPORT



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

March 28, 2022

Dave Fawcett
Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520
TEL: (541) 535-7108
FAX (541) 535-8795

RE: 22-010G Brixner Jr HS

Order No.: 22030638

Dear Dave Fawcett:

Neilson Research Corporation received 57 sample(s) on 3/11/2022 for the analyses presented in the following report.

The results relate only to the parameters tested or to the sample as received by the laboratory. This report shall not be reproduced except in full, without the written approval of Neilson Research Corporation. If you have any questions regarding these test results, please feel free to call.

Sincerely,
Neilson Research Corporation

Tamra Schmedemann
Senior Project Manager
245 S Grape St
Medford, OR 97501



Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Case Narrative

WO#: 22030638
Date: 3/28/2022

CLIENT: Coleman Creek Consulting
Project: 22-010G Brixner Jr HS

The analyses were performed according to the guidelines in the Neilson Research Corporation Quality Assurance Program. This report contains analytical results for the sample(s) as received by the laboratory.

Neilson Research Corporation certifies that this report is in compliance with the requirements of NELAP. No unusual difficulties were experienced during analysis of this batch except as noted below or qualified with data flags on the reports.

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-01 **Client Sample ID:** 22-010G.B1
Collection Date: 3/11/2022 6:30:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-02 **Client Sample ID:** 22-010G.B2
Collection Date: 3/11/2022 6:31:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	8.14		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-03 **Client Sample ID:** 22-010G.B3
Collection Date: 3/11/2022 6:32:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.909		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-04 **Client Sample ID:** 22-010G.B4
Collection Date: 3/11/2022 6:35:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.705		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-05 **Client Sample ID:** 22-010G.B5
Collection Date: 3/11/2022 6:40:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.629		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-06 **Client Sample ID:** 22-010G.B6
Collection Date: 3/11/2022 6:40:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-07 **Client Sample ID:** 22-010G.B7
Collection Date: 3/11/2022 6:40:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-08 **Client Sample ID:** 22-010G.B8
Collection Date: 3/11/2022 6:42:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-09 **Client Sample ID:** 22-010G.B9
Collection Date: 3/11/2022 6:42:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-10 **Client Sample ID:** 22-010G.B10
Collection Date: 3/11/2022 6:42:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-11 **Client Sample ID:** 22-010G.B11
Collection Date: 3/11/2022 6:45:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-12 **Client Sample ID:** 22-010G.B12
Collection Date: 3/11/2022 6:46:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.547		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-13 **Client Sample ID:** 22-010G.B13
Collection Date: 3/11/2022 6:46:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-14 **Client Sample ID:** 22-010G.B14
Collection Date: 3/11/2022 6:46:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	4.34		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-15 **Client Sample ID:** 22-010G.B15
Collection Date: 3/11/2022 6:50:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	6.25		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-16 **Client Sample ID:** 22-010G.B16
Collection Date: 3/11/2022 6:50:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	3.16		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-17 **Client Sample ID:** 22-010G.B17
Collection Date: 3/11/2022 6:50:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	10.3		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-18 **Client Sample ID:** 22-010G.B18
Collection Date: 3/11/2022 6:51:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	4.67		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-19 **Client Sample ID:** 22-010G.B19
Collection Date: 3/11/2022 6:52:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.59		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-20 **Client Sample ID:** 22-010G.B20
Collection Date: 3/11/2022 6:54:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.661		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-21 **Client Sample ID:** 22-010G.B21
Collection Date: 3/11/2022 6:54:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.06		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-22 **Client Sample ID:** 22-010G.B22
Collection Date: 3/11/2022 6:54:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	7.82		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-23 **Client Sample ID:** 22-010G.B23
Collection Date: 3/11/2022 6:55:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.961		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-24 **Client Sample ID:** 22-010G.B24
Collection Date: 3/11/2022 6:55:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.615		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-25 **Client Sample ID:** 22-010G.B25
Collection Date: 3/11/2022 6:57:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.595		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-26 **Client Sample ID:** 22-010G.B26
Collection Date: 3/11/2022 6:57:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.43		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-27 **Client Sample ID:** 22-010G.B27
Collection Date: 3/11/2022 6:58:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.893		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-28 **Client Sample ID:** 22-010G.B28
Collection Date: 3/11/2022 6:58:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-29 **Client Sample ID:** 22-010G.B29
Collection Date: 3/11/2022 6:58:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-30 **Client Sample ID:** 22-010G.B30
Collection Date: 3/11/2022 7:00:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-31 **Client Sample ID:** 22-010G.B31
Collection Date: 3/11/2022 7:00:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-32 **Client Sample ID:** 22-010G.B32
Collection Date: 3/11/2022 7:02:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-33 **Client Sample ID:** 22-010G.B33
Collection Date: 3/11/2022 7:05:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-34 **Client Sample ID:** 22-010G.B34
Collection Date: 3/11/2022 7:05:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-35 **Client Sample ID:** 22-010G.B35
Collection Date: 3/11/2022 7:05:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-36 **Client Sample ID:** 22-010G.B36
Collection Date: 3/11/2022 7:07:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-37 **Client Sample ID:** 22-010G.B37
Collection Date: 3/11/2022 7:07:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-38 **Client Sample ID:** 22-010G.B38
Collection Date: 3/11/2022 7:07:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-39 **Client Sample ID:** 22-010G.B39
Collection Date: 3/11/2022 7:10:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/26/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-40 **Client Sample ID:** 22-010G.B40
Collection Date: 3/11/2022 7:10:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	2.01		0.515	ppb	1	3/26/2022	15.0	A

Lab ID: 22030638-41 **Client Sample ID:** 22-010G.B41
Collection Date: 3/11/2022 7:20:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.24		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-42 **Client Sample ID:** 22-010G.B42
Collection Date: 3/11/2022 7:22:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-43 **Client Sample ID:** 22-010G.B43
Collection Date: 3/11/2022 7:22:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	4.15		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-44 **Client Sample ID:** 22-010G.B44
Collection Date: 3/11/2022 7:23:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-45 **Client Sample ID:** 22-010G.B45
Collection Date: 3/11/2022 7:23:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-46 **Client Sample ID:** 22-010G.B46
Collection Date: 3/11/2022 7:25:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-47 **Client Sample ID:** 22-010G.B47
Collection Date: 3/11/2022 7:26:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-48 **Client Sample ID:** 22-010G.B48
Collection Date: 3/11/2022 7:26:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS							Analyst: SJS	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-49 **Client Sample ID:** 22-010G.B49
Collection Date: 3/11/2022 7:35:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-50 **Client Sample ID:** 22-010G.B50
Collection Date: 3/11/2022 7:35:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-51 **Client Sample ID:** 22-010G.B51
Collection Date: 3/11/2022 7:36:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.892		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-52 **Client Sample ID:** 22-010G.B52
Collection Date: 3/11/2022 7:36:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	5.19		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-53 **Client Sample ID:** 22-010G.B53
Collection Date: 3/11/2022 7:37:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-54 **Client Sample ID:** 22-010G.B54
Collection Date: 3/11/2022 7:42:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

Analytical Report

WO#: 22030638

Date Reported: 3/28/2022

Coleman Creek Consulting
810 Leonard St
Ashland, OR 97520

Lab Order: 22030638
Received Date: 3/11/2022 4:16:26 PM
Reported Date: 3/28/2022 2:45:05 PM

Sample Information:

Lab ID: 22030638-55 **Client Sample ID:** 22-010G.B55
Collection Date: 3/11/2022 7:45:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	0.520		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-56 **Client Sample ID:** 22-010G.B56
Collection Date: 3/11/2022 7:45:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.515	ppb	1	3/27/2022	15.0	A

Lab ID: 22030638-57 **Client Sample ID:** 22-010G.B57
Collection Date: 3/11/2022 7:46:00 AM **Collected By:** Kim Pine
Matrix: Drinking Water **Sample Location:**

Trace Metals by EPA 200.8 ICP-MS						Analyst: SJS		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	4.99		0.515	ppb	1	3/27/2022	15.0	A

QUALIFIERS	*	Value exceeds Maximum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcode
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	R	RPD outside accepted recovery limits		

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

QC SUMMARY REPORT

WO#: 22030638

28-Mar-22

Client: Coleman Creek Consulting

Project: 22-010G Brixner Jr HS

TestCode: LEAD_DW

Sample ID: 22030638-20AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28721						
Client ID: 22-010G.B20	Batch ID: 16060	TestNo: E200.8	E200.8	Analysis Date: 3/26/2022	SeqNo: 467024						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	100	0.520	100	0.661	99.6	70	130				
------	-----	-------	-----	-------	------	----	-----	--	--	--	--

Sample ID: 22030638-20AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28721						
Client ID: 22-010G.B20	Batch ID: 16060	TestNo: E200.8	E200.8	Analysis Date: 3/26/2022	SeqNo: 467025						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	99.8	0.520	100	0.661	99.1	70	130	100	0.437	20	
------	------	-------	-----	-------	------	----	-----	-----	-------	----	--

Sample ID: MB-16061	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28721						
Client ID: PBW	Batch ID: 16061	TestNo: E200.8	E200.8	Analysis Date: 3/26/2022	SeqNo: 467028						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	ND	0.515									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: LCS-16061		SampType: LCS		TestCode: LEAD_DW		Units: ppb		Prep Date: 3/16/2022			RunNo: 28721		
Client ID: LCSW		Batch ID: 16061		TestNo: E200.8		E200.8		Analysis Date: 3/26/2022			SeqNo: 467029		
Analyte		Result		PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	104	0.520	100	0	104	85	115				
------	-----	-------	-----	---	-----	----	-----	--	--	--	--

Qualifiers: C1 Sample container temperature is out of limit as specified at testcode
ND Not Detected at the Reporting Limit

H Holding times for preparation or analysis exceeded
PL Permit Limit

MI Recovery outside control limits due to Matrix Int
RL Reporting Detection Limit

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

QC SUMMARY REPORT

WO#: 22030638

28-Mar-22

Client: Coleman Creek Consulting

Project: 22-010G Brixner Jr HS

TestCode: LEAD_DW

Sample ID: 22030638-40AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28721						
Client ID: 22-010G.B40	Batch ID: 16061	TestNo: E200.8	E200.8	Analysis Date: 3/26/2022	SeqNo: 467052						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	103	0.520	100	2.01	101	70	130				
------	-----	-------	-----	------	-----	----	-----	--	--	--	--

Sample ID: 22030638-40AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28721						
Client ID: 22-010G.B40	Batch ID: 16061	TestNo: E200.8	E200.8	Analysis Date: 3/26/2022	SeqNo: 467053						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	105	0.520	100	2.01	103	70	130	103	1.58	20	
------	-----	-------	-----	------	-----	----	-----	-----	------	----	--

Sample ID: MB-16060	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28721						
Client ID: PBW	Batch ID: 16060	TestNo: E200.8	E200.8	Analysis Date: 3/26/2022	SeqNo: 467088						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	ND	0.515									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: LCS-16060		SampType: LCS		TestCode: LEAD_DW		Units: ppb		Prep Date: 3/16/2022			RunNo: 28721		
Client ID: LCSW		Batch ID: 16060		TestNo: E200.8		E200.8		Analysis Date: 3/26/2022			SeqNo: 467089		
Analyte		Result		PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	104	0.520	100	0	104	85	115				
------	-----	-------	-----	---	-----	----	-----	--	--	--	--

Qualifiers: C1 Sample container temperature is out of limit as specified at testcode
ND Not Detected at the Reporting Limit

H Holding times for preparation or analysis exceeded
PL Permit Limit

MI Recovery outside control limits due to Matrix Int
RL Reporting Detection Limit

Original



Neilson Research Corporation
245 S Grape St
Medford, OR 97501
TEL: (541) 770-5678 FAX: (541) 770-2901
Website: www.nrclabs.com

QC SUMMARY REPORT

WO#: 22030638

28-Mar-22

Client: Coleman Creek Consulting

Project: 22-010G Brixner Jr HS

TestCode: LEAD_DW

Sample ID: MB-16062	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: PBW	Batch ID: 16062	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467294
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.515

Sample ID: LCS-16062	SampType: LCS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: LCSW	Batch ID: 16062	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467295
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 102 0.520 100 0 102 85 115

Sample ID: 22030638-57AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: 22-010G.B57	Batch ID: 16062	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467315
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 109 0.520 100 4.99 104 70 130

Sample ID: 22030638-57AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 3/16/2022	RunNo: 28717
Client ID: 22-010G.B57	Batch ID: 16062	TestNo: E200.8	E200.8	Analysis Date: 3/27/2022	SeqNo: 467316
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 108 0.520 100 4.99 103 70 130 109 0.656 20

Qualifiers: CI Sample container temperature is out of limit as specified at testcode
ND Not Detected at the Reporting Limit

H Holding times for preparation or analysis exceeded
PL Permit Limit

MI Recovery outside control limits due to Matrix Int
RL Reporting Detection Limit

Original

Sample Log-In Check List

Client Name: **ColemanCreek**

Work Order Number: **22030638**

RcptNo: **1**

Logged by: **Tamra Schmedemann** **3/11/2022 4:16:26 PM**

Completed By: **Katherine Root** **3/17/2022 11:03:49 AM**

Reviewed By: **Tamra Schmedemann** **3/28/2022 12:30:09 PM**

Tamra Schmedemann
Katherine Root
Tamra Schmedemann

Chain of Custody

1. Is Chain of Custody complete? Yes ☒ No ☐ Not Present ☐
2. How was the sample delivered? Client

Log In

3. Coolers are present? Yes ☐ No ☐ NA ☒
4. Shipping container/cooler in good condition? Yes ☒ No ☐
Custody seals intact on shipping container/cooler? Yes ☐ No ☐ Not Present ☒
No. Seal Date: Signed By:
5. Was an attempt made to cool the samples? Yes ☐ No ☐ NA ☒
6. Were all samples received at a temperature of $>0^{\circ}\text{C}$ to 6.0°C ? Yes ☐ No ☐ NA ☒
7. Sample(s) in proper container(s)? Yes ☒ No ☐
8. Sufficient sample volume for indicated test(s)? Yes ☒ No ☐
9. Are samples (except VOA and ONG) properly preserved? Yes ☒ No ☐
10. Was preservative added to bottles? Yes ☒ No ☐ NA ☐
11. Is the headspace in the VOA vials less than 1/4 inch or 6 mm? Yes ☐ No ☐ HNO₃ pH<2
No VOA Vials ☒
12. Were any sample containers received broken? Yes ☐ No ☒
13. Does paperwork match bottle labels? Yes ☒ No ☐
(Note discrepancies on chain of custody)
14. Are matrices correctly identified on Chain of Custody? Yes ☒ No ☐
15. Is it clear what analyses were requested? Yes ☒ No ☐
16. Were all holding times able to be met? Yes ☒ No ☐
(If no, notify customer for authorization.)

Special Handling (if applicable)

17. Was client notified of all discrepancies with this order? Yes ☐ No ☐ NA ☒

Person Notified: Date:
By Whom: Via: ☐ eMail ☐ Phone ☐ Fax ☐ In Person
Regarding:
Client Instructions:

18. Additional remarks:

The samples submitted for sample ID 22030638-02A and 14A both contained visible sediments.

Cooler Information

Cooler No	Temp °C	Condition	Seal Intact	Seal No	Seal Date	Signed By
-----------	---------	-----------	-------------	---------	-----------	-----------



This Chain of Custody is a LEGAL DOCUMENT and must be filled out accurately.

Rush Status (Subject to Scheduling)


Company: Coleman Creek Consulting, Inc.		Project Name: Brixner Jr HS		Attention:		X												
Address: 810 Leonard Street		Project Number: 22-010G		Company Name:		___ Priority: 5 Business Days (List x 1.50)												
Ashland, OR 97520		Report To:		Address:		___ Express: 3 Business Days (List x 1.75)												
Email: fawbro@ccountry.net		Copy To:				___ Rush: 2 Business Days (List x 2.00)												
Phone: 541-944-5318 Fax:						___ Rush: Same Day (List x 3.00)												
Collected By (Print): David W. Fawcett		<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center; margin: 0;">Analysis Requested</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> <td style="width: 5%; height: 20px;"></td> </tr> </table> </div>																
Collected By (Sign):																		
Email Report ___ Mail Report ___ Fax Report ___																		
		Authorized ___ Yes ___ No																

Sample Information

[illegible]

*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

Relinquish/Receive


Relinquish/Receive	Sign	Print	Date	Time
Relinquished By:		David W. Faurett	3-11-22	1600
Received By:				
Relinquished By:				
Received By:				
Relinquished By:				
Received By Laboratory:	Tamra Schmolders	Tamra Schmolders	3-21-22	16:00

Lab Use Only

Temp:	<i>40.6</i>	
4°C +/- 2°C:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Received on Ice:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Number of Bottles Received:	<i>52</i>	
pH Checked:	<i>n/a</i>	
COC Seals Intact:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No <i>NA</i>
Field Blank Included:	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No

Received Via ☐ UPS ☐ FedEx ☐ Other ☒ Hand

Payment: ☒ Invoice ☐ Cash ☐ VISA, M/C ☐ Check # ☐ Amount ☐



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Brixner Jr. High School
ADDRESS: 4727 Homedale Road
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Kim Pine

NRC WD 22030638

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME	
01-18A	22-010G.B1	DW	Hall Fountain at Room 3	6:30 AM	6:30
02-19A	22-010G.B2	DW	Library South Faucet		6:31
03-20A	22-010G.B3	DW	Library North Faucet		6:32
04-21A	22-010G.B4	DW	Hall Fountain at Room 12		6:35
05-22A	22-010G.B5	DW	Girl's Hall RR at Conference Room L Faucet		6:40
06-23A	22-010G.B6	DW	Girl's Hall RR at Conference Room M Faucet		6:40
07-24A	22-010G.B7	DW	Girl's Hall RR at Conference Room R Faucet		6:40
08-25A	22-010G.B8	DW	Boy's Hall RR at Conference Room L Faucet		6:42
09-26A	22-010G.B9	DW	Boy's Hall RR at Conference Room M Faucet		6:42
10-27A	22-010G.B10	DW	Boy's Hall RR at Conference Room R Faucet		6:42
11-28A	22-010G.B11	DW	Staff Lounge Faucet		6:45
12-29A	22-010G.B12	DW	Office Men's RR Faucet		6:46
13-30A	22-010G.B13	DW	Office Women's RR Faucet		6:46
14-31A	22-010G.B14	DW	Office Sink Faucet Next to Women's RR		6:46
15-32A	22-010G.B15	DW	Room 14 L Faucet		6:50
16-33A	22-010G.B16	DW	Room 14 LM Faucet		6:50
17-34A	22-010G.B17	DW	Room 14 RM Faucet		6:50
18-35A	22-010G.B18	DW	Room 14 R Faucet		6:51
19-36A	22-010G.B19	DW	Cafeteria Fountain at Room 14		6:52
20-37A	22-010G.B20	DW	Room 15 L Faucet	8:00	6:54

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Brixner Jr. High School
ADDRESS: 4727 Homedale Road
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Kim Pine

NRCWG 22 030638

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME	
21-38A	22-010G.B21	DW	Room 15 LM Faucet	6:30 AM	6:54
22-39A	22-010G.B22	DW	Room 15 RM Faucet		6:54
23-40A	22-010G.B23	DW	Room 15 R Faucet		6:55
24-41A	22-010G.B24	DW	Room 16 L Faucet		6:55
25-42A	22-010G.B25	DW	Room 16 LM Faucet		6:57
26-43A	22-010G.B26	DW	Room 16 LMM Faucet		6:57
27-44A	22-010G.B27	DW	Room 16 RMM Faucet		6:58
28-45A	22-010G.B28	DW	Room 16 RM Faucet		6:58
29-46A	22-010G.B29	DW	Room 16 R Faucet		6:58
30-47A	22-010G.B30	DW	Room 17 SPED Faucet		7:00
31-48A	22-010G.B31	DW	Room 17 RR Faucet		7:00
32-49A	22-010G.B32	DW	Cafeteria Fountain at Room 17		7:02
33-50A	22-010G.B33	DW	Boy's PEN RR L Faucet		7:05
34-51A	22-010G.B34	DW	Boy's PEN RR M Faucet		7:05
35-52A	22-010G.B35	DW	Boy's PEN RR R Faucet		7:05
36-53A	22-010G.B36	DW	Girl's PEN RR L Faucet		7:07
37-54A	22-010G.B37	DW	Girl's PEN RR M Faucet		7:07
38-55A	22-010G.B38	DW	Girl's PEN RR R Faucet		7:07
39-56A	22-010G.B39	DW	Kitchen Sink Faucet Facing Walk-in		7:10
40-57A	22-010G.B40	DW	Kitchen Double Sink Faucet	5:00 PM	7:10

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle



Coleman Creek Consulting, Inc.

DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Brixner Jr. High School
ADDRESS: 4727 Homedale Road
Klamath Falls, Oregon

DATE: 03-11-22
SAMPLER: Kim Pine

NR 000 22030638

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME	
41 01A	22-010G.B41	DW	Room 18 Fountain	6:30 AM	7:20
42 02A	22-010G.B42	DW	Girl's Locker Outside Office Faucet		7:22
43 03A	22-010G.B43	DW	Gym Fountain at Girl's Locker		7:22
44 04A	22-010G.B44	DW	Girl's Locker L Faucet		7:27
45 05A	22-010G.B45	DW	Girl's Locker R Faucet		7:27
46 06A	22-010G.B46	DW	Girl's Locker Outside Office Faucet		7:25
47 07A	22-010G.B47	DW	Boy's Locker L Faucet		7:26
48 08A	22-010G.B48	DW	Boy's Locker R Faucet		7:26
49 09A	22-010G.B49	DW	Shop Building RR Faucet		7:35
50 10A	22-010G.B50	DW	Shop Building L Faucet		7:35
51 11A	22-010G.B51	DW	Shop Building LM Faucet		7:36
52 12A	22-010G.B52	DW	Shop Building RM Faucet		7:36
53 13A	22-010G.B53	DW	Shop Building R Faucet		7:37
54 14A	22-010G.B54	DW	Boiler Room RR Faucet		7:42
55 15A	22-010G.B55	DW	Room 19 L Sink		7:45
56 16A	22-010G.B56	DW	Room 19 M Sink		7:45
57 17A	22-010G.B57	DW	Room 19 R Sink	8:00 AM	7:46

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle
LM = Left Middle LMM = Left Middle Middle RMM = Right Middle Middle M = Middle