

Coleman Creek Consulting, Inc.

**DRINKING WATER LEAD SAMPLING**  
**OF**  
**HENLEY ELEMENTARY SCHOOL**  
**8245 HWY. 39, KLAMATH FALLS, OREGON**  
**FOR**  
**KLAMATH COUNTY SCHOOL DISTRICT**

**INTRODUCTION**


Coleman Creek Consulting, Inc. (CCC) was retained by Klamath County School District (KCS D) to perform representative lead drinking water sampling of Henley Elementary School at the above address. The purpose of the lead drinking water sampling was to determine the concentration of lead in representative drinking water sources and compare with regulatory standards. In 2017, Education Service Districts were required to adopt a Healthy and Safe Schools Plan, including provisions for testing and reducing exposure to elevated levels of lead in water used for drinking and food preparation.

**LEAD DRINKING WATER SAMPLING REQUIREMENTS**

Guidelines for sampling lead in water were established by the Oregon Health Authority. Water sampling is to occur after water sits overnight in the pipes without being used, and must be sampled after a day occupied by students or building occupants. All water sources are to be sampled, with the exception of water used for heating, sanitation, irrigation, and science sinks for grades 6 and up with non-potable water signs. Initial testing is required to be performed by 2020, and every 6 years thereafter, according to a testing schedule determined by the Oregon Department of Education.

**SAMPLE LOCATION DETERMINATION/SAMPLE PREP**

David W. Fawcett of CCC contacted Darrell Walker, Head Custodian at Henley Elementary School, and discussed the objectives of the lead drinking water program. Mr. Walker reviewed the School building for water sources and identified by type on a building floor plan. Mr. Fawcett and Mr. Walker discussed the drinking water sources by phone, and Mr. Fawcett created a Site Sample Record Sheet describing each drinking water source by type and location. Mr. Fawcett identified each source by number (1-74), and identified each source number on a floor plan diagram of the school buildings. Mr. Fawcett delivered the following sampling materials to Mr. Walker January 15, 2025: Numbered sample containers, Site Sample Record Sheet filled out with Sample Number, Sample Type, and Location. Mr. Walker was instructed in proper sampling technique, including sampling prior to water system use by other school occupants, fill sample container immediately from faucet opening, and recording time of water sampling on the Site Sample Record Sheets (pages 3-6).



# Coleman Creek Consulting, Inc.

## **DRINKING WATER SAMPLING**

Mr. Walker collected lead drinking water samples from the drinking water sources identified in Henley Elementary School January 16, 2025. See Site Sample Record Sheets (pages 3-6) for a description of the drinking water sources sampled. See Drinking Water Sample Location Diagram in Appendix A for a visual review of all drinking water sample locations. The drinking water samples were collected in the early morning, ensuring that the sample source had not been in use since the previous day. The samples were placed in a cooler. Mr. Fawcett picked up the samples collected by Mr. Walker January 16, 2025, and transported to Neilson Research Corporation in Medford, Oregon.

## **DRINKING WATER LEAD RESULTS AND TESTING SUMMARY SHEETS**

The seventy-four (74) drinking water samples collected were analyzed for lead using EPA Method 200.8. See Neilson Research Corporation Analytical Report in Appendix B. Drinking Water Testing Summary Sheets (pages 7-9) indicate the lead in drinking water concentrations for the seventy-four (74) samples collected from Henley Elementary School were reported ranging from <0.5 to 1.49 parts per billion (ppb).


## **CONCLUSIONS**

Seventy-four (74) drinking water samples were collected from drinking water sources at Henley Elementary School prior to use that day by building occupants, and after a day the facility was occupied. The lead concentrations reported were all below the 15 ppb lead action level in water.

## **RECOMMENDATIONS**

Coleman Creek Consulting, Inc. recommends continuing the lead drinking water sampling schedule in the future. Coleman Creek Consulting, Inc. appreciates the opportunity to continue to perform environmental sampling and consulting services to Klamath County School District.

David W. Fawcett  
Director of Consulting Services



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
24-165G.1	DW	Kitchen Right Handwash Sink Faucet	0457
24-165G.2	DW	Kitchen Middle Handwash Sink Faucet	0457
24-165G.3	DW	Kitchen Restroom Sink Faucet	0458
24-165G.4	DW	Kitchen Right Handwash Sink Faucet	0459
24-165G.5	DW	Kitchen Sink Faucet	0501
24-165G.6	DW	Kitchen Pot Filler Sink Faucet	0502
24-165G.7	DW	Room P116 Sink	0504
24-165G.8	DW	Cafeteria Bottle Fill Fountain	0506
24-165G.9	DW	Cafeteria Drinking Fountain	0507
24-165G.10	DW	Gym Hall Left Drinking Fountain	0507
24-165G.11	DW	Gym Hall Right Drinking Fountain	0508
24-165G.12	DW	Girl's Bath at Gym Left Sink Faucet	0509
24-165G.13	DW	Girl's Bath at Gym Left Middle Sink Faucet	0509
24-165G.14	DW	Girl's Bath at Gym Right Middle Sink Faucet	0510
24-165G.15	DW	Girl's Bath at Gym Right Sink Faucet	0510
24-165G.16	DW	Boy's Bath at Gym Left Sink Faucet	0511
24-165G.17	DW	Boy's Bath at Gym Left Middle Sink Faucet	0511
24-165G.18	DW	Boy's Bath at Gym Right Middle Sink Faucet	0512
24-165G.19	DW	Boy's Bath at Gym Right Sink Faucet	0512
24-165G.20	DW	Family Restroom Sink Faucet	0514

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
24-165G.21	DW	Aspen Hall Left Drinking Fountain	0517
24-165G.22	DW	Aspen Hall Right Drinking Fountain	0517
24-165G.23	DW	Aspen Boy's Bath Left Sink Faucet	0523
24-165G.24	DW	Aspen Boy's Bath Left Middle Sink Faucet	0523
24-165G.25	DW	Aspen Boy's Bath Right Middle Sink Faucet	0525
24-165G.26	DW	Aspen Boy's Bath Right Sink Faucet	0525
24-165G.27	DW	Aspen Girl's Bath Left Sink Faucet	0526
24-165G.28	DW	Aspen Girl's Bath Left Middle Sink Faucet	0526
24-165G.29	DW	Aspen Girl's Bath Right Middle Sink Faucet	0528
24-165G.30	DW	Aspen Girl's Bath Right Sink Faucet	0528
24-165G.31	DW	Room 106A Sink Faucet	0532
24-165G.32	DW	Room 105A Sink Faucet	0536
24-165G.33	DW	Room 104A Sink Faucet	0537
24-165G.34	DW	Room 103A Sink Faucet	0538
24-165G.35	DW	Room 102A Sink Faucet	0541
24-165G.36	DW	Room 101A Sink Faucet	0542
24-165G.37	DW	Room 100A Sink Faucet	0543
24-165G.38	DW	Aspen Staff Restroom Sink Faucet	0545
24-165G.39	DW	Speech Room Sink Faucet	0547
24-165G.40	DW	ELL Room Sink Faucet	0548

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
24-165G.41	DW	Staff Lounge Sink Faucet	0535
24-165G.42	DW	Staff Right Bath Sink Faucet	0537
24-165G.43	DW	Staff Left Bath Sink Faucet	0539
24-165G.44	DW	Nurse Office Bath Sink Faucet	0541
24-165G.45	DW	Norse Office Sink Faucet	0543
24-165G.46	DW	Room W108 Kinder Bath Sink Faucet	0545
24-165G.47	DW	Room W108 Sink Faucet	0547
24-165G.48	DW	Room W107 Sink Faucet	0549
24-165G.49	DW	Room W107 Kinder Bath Sink Faucet	0551
24-165G.50	DW	Room J100 Sink Faucet	0552
24-165G.51	DW	Room J100 Kinder Bath Sink Faucet	0553
24-165G.52	DW	Room J101 Sink Faucet	0555
24-165G.53	DW	Room J102 Sink Faucet	0556
24-165G.54	DW	Room J103 Sink Faucet	0558
24-165G.55	DW	Room J104 Sink Faucet	0600
24-165G.56	DW	Room J105 Sink Faucet	0602
24-165G.57	DW	Room J106 Sink Faucet	0602
24-165G.58	DW	Willow Boy's Bath Left Sink Faucet	0603
24-165G.59	DW	Willow Boy's Bath Left Middle Sink Faucet	0604
24-165G.60	DW	Willow Boy's Bath Right Middle Sink Faucet	0605

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

SAMPLE #	SAMPLE TYPE	LOCATION	TIME
24-165G.61	DW	Willow Boy's Bath Right Sink Faucet	0606
24-165G.62	DW	Willow Girl's Bath Left Sink Faucet	0607
24-165G.63	DW	Willow Girl's Bath Left Middle Sink Faucet	0608
24-165G.64	DW	Willow Girl's Bath Right Middle Sink Faucet	0609
24-165G.65	DW	Willow Girl's Bath Right Sink Faucet	0609
24-165G.66	DW	Willow Staff Bath Sink Faucet	0603
24-165G.67	DW	Room W100 Sink Faucet	0608
24-165G.68	DW	Room W101 Sink Faucet	0608
24-165G.69	DW	Room W102 Sink Faucet	0610
24-165G.70	DW	Room W103 Sink Faucet	0611
24-165G.71	DW	Room W104 Sink Faucet	0612
24-165G.72	DW	Room W105 Sink Faucet	0613
24-165G.73	DW	Juniper Hall Left Drinking Fountain	0605
24-165G.74	DW	Juniper Hall Right Drinking Fountain	0605

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET


DISTRICT NAME: Klamath County School District  
DISTRICT ID#: 467  
SCHOOL NAME: Henley Elementary School  
BUILDING NAME: Henley Elementary School  
BUILDING ID#: 20570600

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
25-165G.1	Kitchen Right Handwash Sink	20570600-001KF	01-16-25	<0.5		<0.5
25-165G.2	Kitchen Middle Handwash Sink	20570600-002KF	01-16-25	<0.5		<0.5
25-165G.3	Kitchen Restroom Sink	20570600-003KF	01-16-25	1.09		1.09
25-165G.4	Kitchen Right Handwash Sink	20570600-004KF	01-16-25	<0.5		<0.5
25-165G.5	Kitchen Sink	20570600-005KF	01-16-25	1.49		1.49
25-165G.6	Kitchen Pot Filler Sink	20570600-006KF	01-16-25	<0.5		<0.5
25-165G.7	Room P116 Sink	20570600-007CF	01-16-25	<0.5		<0.5
25-165G.8	Cafeteria Bottle Fill	20570600-008BF	01-16-25	<0.5		<0.5
25-165G.9	Cafeteria Fountain	20570600-009DW	01-16-25	<0.5		<0.5
25-165G.10	Gym Hall Left Fountain	20570600-010DW	01-16-25	<0.5		<0.5
25-165G.11	Gym Hall Right Fountain	20570600-011DW	01-16-25	<0.5		<0.5
25-165G.12	Girl's Bath at Gym Left Sink	20570600-012BF	01-16-25	<0.5		<0.5
25-165G.13	Girl's Bath at Gym Left Middle Sink	20570600-013BF	01-16-25	<0.5		<0.5
25-165G.14	Girl's Bath at Gym Right Middle Sink	20570600-014BF	01-16-25	<0.5		<0.5
25-165G.15	Girl's Bath at Gym Right Sink	20570600-015BF	01-16-25	<0.5		<0.5
25-165G.16	Boy's Bath at Gym Left Sink	20570600-016BF	01-16-25	<0.5		<0.5
25-165G.17	Boy's Bath at Gym Left Middle Sink	20570600-017BF	01-16-25	<0.5		<0.5
25-165G.18	Boy's Bath at Gym Right Middle Sink	20570600-018BF	01-16-25	<0.5		<0.5
25-165G.19	Boy's Bath at Gym Right Sink	20570600-019BF	01-16-25	<0.5		<0.5
25-165G.20	Family Restroom Sink	20570600-020BF	01-16-25	<0.5		<0.5
25-165G.21	Aspen Hall Left Fountain	20570600-021DW	01-16-25	<0.5		<0.5
25-165G.22	Aspen Hall Right Fountain	20570600-022DW	01-16-25	<0.5		<0.5
25-165G.23	Aspen Boy's Bath Left Sink	20570600-023BF	01-16-25	<0.5		<0.5
25-165G.24	Aspen Boy's Bath Left Middle Sink	20570600-024BF	01-16-25	<0.5		<0.5
25-165G.25	Aspen Boy's Bath Right Middle Sink	20570600-025BF	01-16-25	<0.5		<0.5

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)



# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
DISTRICT ID#: 467  
SCHOOL NAME: Henley Elementary School  
BUILDING NAME: Henley Elementary School  
BUILDING ID#: 20570600


Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
25-165G.26	Aspen Boy's Bath Right Sink	20570600-026BF	01-16-25	<0.5		<0.5
25-165G.27	Aspen Girl's Bath Left Sink	20570600-027BF	01-16-25	<0.5		<0.5
25-165G.28	Aspen Girl's Bath Left Middle Sink	20570600-028BF	01-16-25	<0.5		<0.5
25-165G.29	Aspen Girl's Bath Right Middle Sink	20570600-029BF	01-16-25	<0.5		<0.5
25-165G.30	Aspen Girl's Bath Right Sink	20570600-030BF	01-16-25	<0.5		<0.5
25-165G.31	Room 106A Sink	20570600-031CF	01-16-25	<0.5		<0.5
25-165G.32	Room 105A Sink	20570600-032CF	01-16-25	<0.5		<0.5
25-165G.33	Room 104A Sink	20570600-033CF	01-16-25	<0.5		<0.5
25-165G.34	Room 103A Sink	20570600-034CF	01-16-25	<0.5		<0.5
25-165G.35	Room 102A Sink	20570600-035CF	01-16-25	<0.5		<0.5
25-165G.36	Room 101A Sink	20570600-036CF	01-16-25	<0.5		<0.5
25-165G.37	Room 100A Sink	20570600-037CF	01-16-25	<0.5		<0.5
25-165G.38	Aspen Staff Restroom Sink	20570600-038BF	01-16-25	<0.5		<0.5
25-165G.39	Speech Room Sink	20570600-039CF	01-16-25	<0.5		<0.5
25-165G.40	ELL Room Sink	20570600-040CF	01-16-25	<0.5		<0.5
25-165G.41	Staff Lounge Sink	20570600-041SF	01-16-25	<0.5		<0.5
25-165G.42	Staff Right Bath Sink	20570600-042BF	01-16-25	<0.5		<0.5
25-165G.43	Staff Left Bath Sink	20570600-043BF	01-16-25	<0.5		<0.5
25-165G.44	Nurse Office Bath Sink	20570600-044BF	01-16-25	<0.5		<0.5
25-165G.45	Norse Office Sink	20570600-045SF	01-16-25	<0.5		<0.5
25-165G.46	Room W108 Kinder Bath Sink	20570600-046BF	01-16-25	<0.5		<0.5
25-165G.47	Room W108 Sink	20570600-047CF	01-16-25	<0.5		<0.5
25-165G.48	Room W107 Sink	20570600-048CF	01-16-25	<0.5		<0.5
25-165G.49	Room W107 Kinder Bath Sink	20570600-049BF	01-16-25	<0.5		<0.5
25-165G.50	Room J100 Sink	20570600-050CF	01-16-25	<0.5		<0.5

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**

DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)





# Coleman Creek Consulting, Inc.

## DRINKING WATER TESTING SUMMARY SHEET

DISTRICT NAME: Klamath County School District  
DISTRICT ID#: 467  
SCHOOL NAME: Henley Elementary School  
BUILDING NAME: Henley Elementary School  
BUILDING ID#: 20570600

Sample Number	Fixture Location/ Description	Fixture ID#	Test Date	Test Result (ppb)	# Retest	Final Result (ppb)
25-165G.51	Room J100 Kinder Bath Sink	20570600-051BF	01-16-25	<0.5		<0.5
25-165G.52	Room J101 Sink	20570600-052CF	01-16-25	<0.5		<0.5
25-165G.53	Room J102 Sink	20570600-053CF	01-16-25	<0.5		<0.5
25-165G.54	Room J103 Sink	20570600-054CF	01-16-25	<0.5		<0.5
25-165G.55	Room J104 Sink	20570600-055CF	01-16-25	<0.5		<0.5
25-165G.56	Room J105 Sink	20570600-056CF	01-16-25	<0.5		<0.5
25-165G.57	Room J106 Sink	20570600-057CF	01-16-25	<0.5		<0.5
25-165G.58	Willow Boy's Bath Left Sink	20570600-058BF	01-16-25	<0.5		<0.5
25-165G.59	Willow Boy's Bath Left Middle Sink	20570600-059BF	01-16-25	<0.5		<0.5
25-165G.60	Willow Boy's Bath Right Middle Sink	20570600-060BF	01-16-25	<0.5		<0.5
25-165G.61	Willow Boy's Bath Right Sink	20570600-061BF	01-16-25	<0.5		<0.5
25-165G.62	Willow Girl's Bath Left Sink	20570600-062BF	01-16-25	<0.5		<0.5
25-165G.63	Willow Girl's Bath Left Middle Sink	20570600-063BF	01-16-25	<0.5		<0.5
25-165G.64	Willow Girl's Bath Right Middle Sink	20570600-064BF	01-16-25	<0.5		<0.5
25-165G.65	Willow Girl's Bath Right Sink	20570600-065BF	01-16-25	<0.5		<0.5
25-165G.66	Willow Staff Bath Sink	20570600-066BF	01-16-25	<0.5		<0.5
25-165G.67	Room W100 Sink	20570600-067CF	01-16-25	<0.5		<0.5
25-165G.68	Room W101 Sink	20570600-068CF	01-16-25	<0.5		<0.5
25-165G.69	Room W102 Sink	20570600-069CF	01-16-25	<0.5		<0.5
25-165G.70	Room W103 Sink	20570600-070CF	01-16-25	<0.5		<0.5
25-165G.71	Room W104 Sink	20570600-071CF	01-16-25	<0.5		<0.5
25-165G.72	Room W105 Sink	20570600-072CF	01-16-25	<0.5		<0.5
25-165G.73	Juniper Hall Left Fountain	20570600-073DW	01-16-25	<0.5		<0.5
25-165G.74	Juniper Hall Right Fountain	20570600-074DW	01-16-25	<0.5		<0.5

Fixture ID Coding:

**Bold Indicates Test Result >15 ppb**


DW = Drinking Water Fountain WC = Water Cooler WB = Water Bottle Filler  
CF = Classroom Faucet BF = Bathroom Faucet SF = Staff/Office Faucet  
KF = Kitchen/Food Prep OS = Outside Spigot OT = Other (Specify)

**APPENDIX A**

**DRINKING WATER SAMPLE LOCATION  
DIAGRAM**

# **DRINKING WATER SAMPLE LOCATION DIAGRAM**

## **Henley Elementary School**

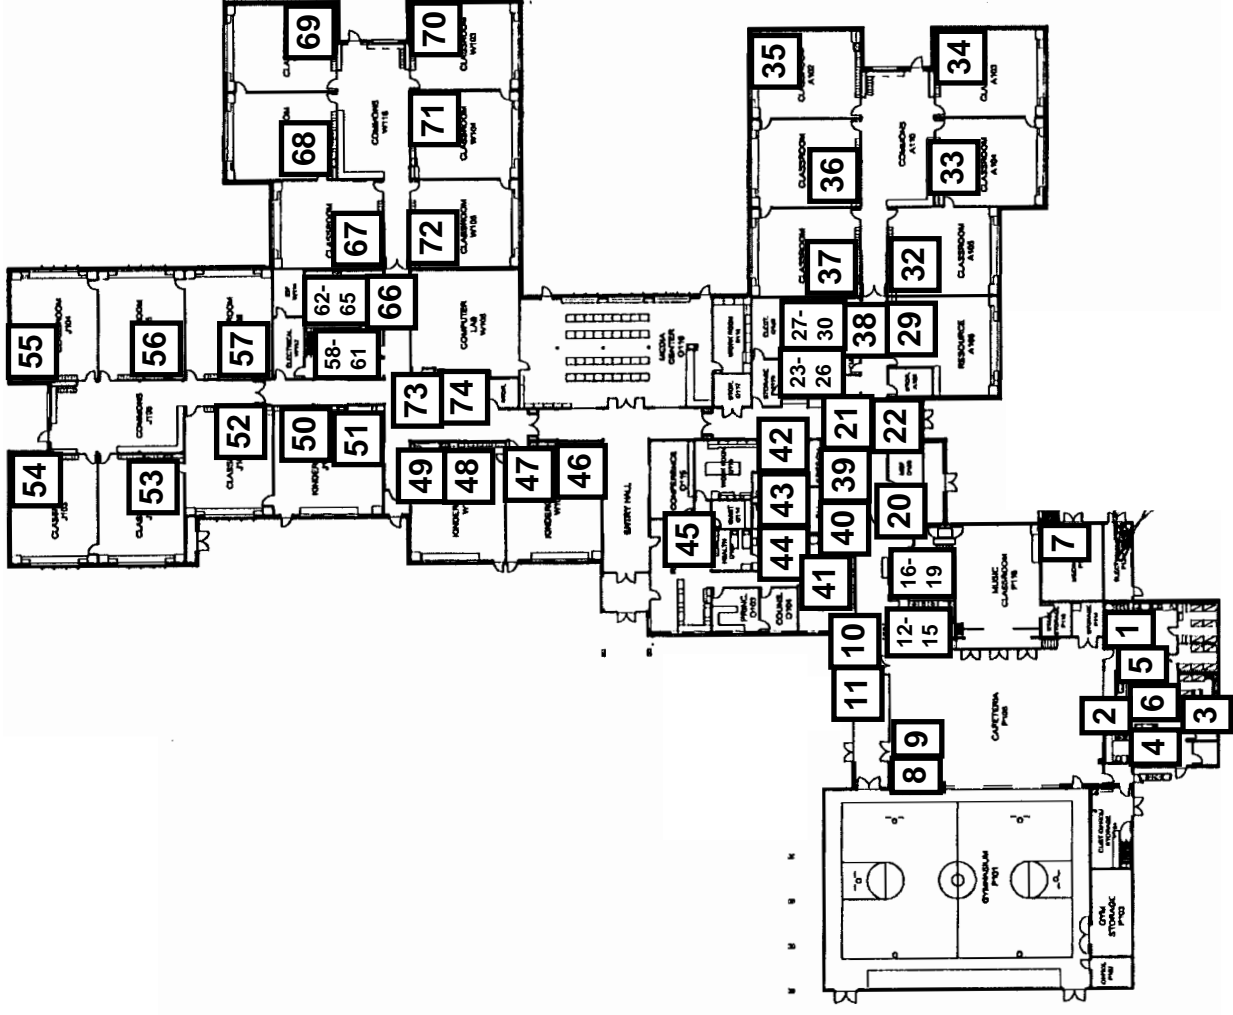

**12** = Drinking Water Sample Location

## **APPENDIX B**

### **NEILSON RESEARCH CORPORATION ANALYTICAL REPORT**



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: [www.nrclabs.com](http://www.nrclabs.com)

January 28, 2025

Dave Fawcett  
Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520  
TEL: (541) 535-7108  
FAX (541) 535-8795

RE: 24-165G Henley ES

Order No.: 25010675

Dear Dave Fawcett:

Neilson Research Corporation received 74 sample(s) on 1/16/2025 for the analyses presented in the following report.

The results relate only to the parameters tested or to the sample as received by the laboratory. This report shall not be reproduced except in full, without the written approval of Neilson Research Corporation. If you have any questions regarding these test results, please feel free to call.

Sincerely,  
Neilson Research Corporation

Tamra Schmedemann  
Senior Project Manager  
245 S Grape St  
Medford, OR 97501



Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: [www.nrclabs.com](http://www.nrclabs.com)

## Case Narrative

WO#: 25010675  
Date: 1/28/2025

---

**CLIENT:** Coleman Creek Consulting  
**Project:** 24-165G Henley ES

---

The analyses were performed according to the guidelines in the Neilson Research Corporation Quality Assurance Program. This report contains analytical results for the sample(s) as received by the laboratory.

Neilson Research Corporation certifies that this report is in compliance with the requirements of NELAP. No unusual difficulties were experienced during analysis of this batch except as noted below or qualified with data flags on the reports.

---

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

**Lab Order:** 25010675  
**Received Date:** 1/16/2025 2:54:00 PM  
**Reported Date:** 1/28/2025 11:37:59 AM

Sample Information:

**Lab ID:** 25010675-01 **Client Sample ID:** 24-165G.1  
**Collection Date:** 1/16/2025 4:57:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Kitchen R Handwash Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

**Lab ID:** 25010675-02 **Client Sample ID:** 24-165G.2  
**Collection Date:** 1/16/2025 4:57:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Kitchen M Handwash Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

**Lab ID:** 25010675-03 **Client Sample ID:** 24-165G.3  
**Collection Date:** 1/16/2025 4:58:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Kitchen RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.09		0.500	ppb	1	1/22/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

**NELAP** NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675

Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

**Lab Order:** 25010675  
**Received Date:** 1/16/2025 2:54:00 PM  
**Reported Date:** 1/28/2025 11:37:59 AM

Sample Information:

**Lab ID:** 25010675-04      Client Sample ID: 24-165G.4  
Collection Date: 1/16/2025 4:59:00 AM      Collected By: Darrell Walker  
Matrix: Drinking Water      Sample Location: Kitchen R Handwash Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

**Lab ID:** 25010675-05      Client Sample ID: 24-165G.5  
Collection Date: 1/16/2025 5:01:00 AM      Collected By: Darrell Walker  
Matrix: Drinking Water      Sample Location: Kitchen Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	1.49		0.500	ppb	1	1/22/2025	15.0	A

**Lab ID:** 25010675-06      Client Sample ID: 24-165G.6  
Collection Date: 1/16/2025 5:02:00 AM      Collected By: Darrell Walker  
Matrix: Drinking Water      Sample Location: Kitchen Pot Filler Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

**NELAP** NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original





Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675

Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

**Lab Order:** 25010675  
**Received Date:** 1/16/2025 2:54:00 PM  
**Reported Date:** 1/28/2025 11:37:59 AM

Sample Information:

**Lab ID:** 25010675-07 **Client Sample ID:** 24-165G.7  
**Collection Date:** 1/16/2025 5:04:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Rm P116 Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

**Lab ID:** 25010675-08 **Client Sample ID:** 24-165G.8  
**Collection Date:** 1/16/2025 5:06:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Cafeteria Bottle Fill Ftn

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

**Lab ID:** 25010675-09 **Client Sample ID:** 24-165G.9  
**Collection Date:** 1/16/2025 5:07:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Cafeteria Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

**NELAP** NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-10 Client Sample ID: 24-165G.10  
Collection Date: 1/16/2025 5:07:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Gym Hall L Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-11 Client Sample ID: 24-165G.11  
Collection Date: 1/16/2025 5:08:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Gym Hall R Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-12 Client Sample ID: 24-165G.12  
Collection Date: 1/16/2025 5:09:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Girl's RR Gym L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-13 Client Sample ID: 24-165G.13  
Collection Date: 1/16/2025 5:09:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Girl's RR at Gym LM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-14 Client Sample ID: 24-165G.14  
Collection Date: 1/16/2025 5:10:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Girl's RR at Gym RM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-15 Client Sample ID: 24-165G.15  
Collection Date: 1/16/2025 5:10:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Girl's RR at Gym R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-16 Client Sample ID: 24-165G.16  
Collection Date: 1/16/2025 5:11:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Boy's RR at Gym L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-17 Client Sample ID: 24-165G.17  
Collection Date: 1/16/2025 5:11:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Boy's RR at Gym LM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-18 Client Sample ID: 24-165G.18  
Collection Date: 1/16/2025 5:12:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Boy's RR at Gym RM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-19 Client Sample ID: 24-165G.19  
Collection Date: 1/16/2025 5:12:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Boy's RR at Gym R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/22/2025	15.0	A

Lab ID: 25010675-20 Client Sample ID: 24-165G.20  
Collection Date: 1/16/2025 5:14:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Family RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-21 Client Sample ID: 24-165G.21  
Collection Date: 1/16/2025 5:17:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Hall L Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-22 Client Sample ID: 24-165G.22  
Collection Date: 1/16/2025 5:17:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Hall R Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-23 Client Sample ID: 24-165G.23  
Collection Date: 1/16/2025 5:23:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Boy's RR L Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-24 Client Sample ID: 24-165G.24  
Collection Date: 1/16/2025 5:23:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Boy's RR LM Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-25 Client Sample ID: 24-165G.25  
Collection Date: 1/16/2025 5:25:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Boy's RR RM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-26 Client Sample ID: 24-165G.26  
Collection Date: 1/16/2025 5:25:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Boy's RR R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-27 Client Sample ID: 24-165G.27  
Collection Date: 1/16/2025 5:26:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Girl's RR L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-28 Client Sample ID: 24-165G.28  
Collection Date: 1/16/2025 5:26:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Girl's RR LM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-29 Client Sample ID: 24-165G.29  
Collection Date: 1/16/2025 5:28:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Girl's RR RM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-30 Client Sample ID: 24-165G.30  
Collection Date: 1/16/2025 5:28:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Girls RR R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original





Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675

Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-31 Client Sample ID: 24-165G.31  
Collection Date: 1/16/2025 5:32:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 106A Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-32 Client Sample ID: 24-165G.32  
Collection Date: 1/16/2025 5:36:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 105A Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-33 Client Sample ID: 24-165G.33  
Collection Date: 1/16/2025 5:37:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 104A Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-34 Client Sample ID: 24-165G.34  
Collection Date: 1/16/2025 5:38:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 103A Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-35 Client Sample ID: 24-165G.35  
Collection Date: 1/16/2025 5:41:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 102A Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-36 Client Sample ID: 24-165G.36  
Collection Date: 1/16/2025 5:42:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 101A Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-37 Client Sample ID: 24-165G.37  
Collection Date: 1/16/2025 5:43:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm 100A Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-38 Client Sample ID: 24-165G.38  
Collection Date: 1/16/2025 5:45:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Aspen Staff RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-39 Client Sample ID: 24-165G.39  
Collection Date: 1/16/2025 5:47:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Speech Rm Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-40 Client Sample ID: 24-165G.40  
Collection Date: 1/16/2025 5:48:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: ELL Rm Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-41 Client Sample ID: 24-165G.41  
Collection Date: 1/16/2025 5:35:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Staff Lounge Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-42 Client Sample ID: 24-165G.42  
Collection Date: 1/16/2025 5:37:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Staff R RR Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-43 Client Sample ID: 24-165G.43  
Collection Date: 1/16/2025 5:39:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Staff L RR Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-44 Client Sample ID: 24-165G.44  
Collection Date: 1/16/2025 5:41:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Nurse Office RR Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

Lab ID: 25010675-45 Client Sample ID: 24-165G.45  
Collection Date: 1/16/2025 5:43:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Nurse Office Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675

Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

**Lab Order:** 25010675  
**Received Date:** 1/16/2025 2:54:00 PM  
**Reported Date:** 1/28/2025 11:37:59 AM

Sample Information:

**Lab ID:** 25010675-46 **Client Sample ID:** 24-165G.46  
**Collection Date:** 1/16/2025 5:45:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Rm W108 Kinder RR Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/23/2025	15.0	A

**Lab ID:** 25010675-47 **Client Sample ID:** 24-165G.47  
**Collection Date:** 1/16/2025 5:47:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Rm W108 Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

**Lab ID:** 25010675-48 **Client Sample ID:** 24-165G.48  
**Collection Date:** 1/16/2025 5:49:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Rm W107 Sink

Trace Metals by EPA 200.8 ICP-MS								Analyst: KN
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

**NELAP** NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-49 Client Sample ID: 24-165G.49  
Collection Date: 1/16/2025 5:51:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W107 Kinder RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-50 Client Sample ID: 24-165G.50  
Collection Date: 1/16/2025 5:52:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J100 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-51 Client Sample ID: 24-165G.51  
Collection Date: 1/16/2025 5:53:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J100 Kinder RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-52 Client Sample ID: 24-165G.52  
Collection Date: 1/16/2025 5:55:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J101 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-53 Client Sample ID: 24-165G.53  
Collection Date: 1/16/2025 5:56:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J102 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-54 Client Sample ID: 24-165G.54  
Collection Date: 1/16/2025 5:58:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J103 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original





Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-55 Client Sample ID: 24-165G.55  
Collection Date: 1/16/2025 6:00:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J104 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-56 Client Sample ID: 24-165G.56  
Collection Date: 1/16/2025 6:02:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J105 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-57 Client Sample ID: 24-165G.57  
Collection Date: 1/16/2025 6:02:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm J106 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675

Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

**Lab Order:** 25010675  
**Received Date:** 1/16/2025 2:54:00 PM  
**Reported Date:** 1/28/2025 11:37:59 AM

Sample Information:

**Lab ID:** 25010675-58 **Client Sample ID:** 24-165G.58  
**Collection Date:** 1/16/2025 6:03:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Willow Boy's RR L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

**Lab ID:** 25010675-59 **Client Sample ID:** 24-165G.59  
**Collection Date:** 1/16/2025 6:04:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Willow Boy's RR LM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

**Lab ID:** 25010675-60 **Client Sample ID:** 24-165G.60  
**Collection Date:** 1/16/2025 6:05:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Willow Boy's RR RM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

**NELAP** NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675

Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

**Lab Order:** 25010675  
**Received Date:** 1/16/2025 2:54:00 PM  
**Reported Date:** 1/28/2025 11:37:59 AM

Sample Information:

**Lab ID:** 25010675-61 **Client Sample ID:** 24-165G.61  
**Collection Date:** 1/16/2025 6:06:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Willow Boy's RR R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

**Lab ID:** 25010675-62 **Client Sample ID:** 24-165G.62  
**Collection Date:** 1/16/2025 6:07:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Willow Girl's RR L Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

**Lab ID:** 25010675-63 **Client Sample ID:** 24-165G.63  
**Collection Date:** 1/16/2025 6:08:00 AM **Collected By:** Darrell Walker  
**Matrix:** Drinking Water **Sample Location:** Willow Girl's RR LM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

**NELAP** NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-64 Client Sample ID: 24-165G.64  
Collection Date: 1/16/2025 6:09:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Willow Girl's RR RM Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-65 Client Sample ID: 24-165G.65  
Collection Date: 1/16/2025 6:09:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Willow Girl's RR R Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-66 Client Sample ID: 24-165G.66  
Collection Date: 1/16/2025 6:03:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Willow Staff R RR Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-67 Client Sample ID: 24-165G.67  
Collection Date: 1/16/2025 6:08:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W100 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-68 Client Sample ID: 24-165G.68  
Collection Date: 1/16/2025 6:08:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W101 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-69 Client Sample ID: 24-165G.69  
Collection Date: 1/16/2025 6:10:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W102 Sink

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-70 Client Sample ID: 24-165G.70  
Collection Date: 1/16/2025 6:11:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W103 Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-71 Client Sample ID: 24-165G.71  
Collection Date: 1/16/2025 6:12:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W104 Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-72 Client Sample ID: 24-165G.72  
Collection Date: 1/16/2025 6:13:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Rm W105 Sink

Trace Metals by EPA 200.8 ICP-MS						Analyst: KN		
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## Analytical Report

WO#: 25010675  
Date Reported: 1/28/2025

Coleman Creek Consulting  
810 Leonard St  
Ashland, OR 97520

Lab Order: 25010675  
Received Date: 1/16/2025 2:54:00 PM  
Reported Date: 1/28/2025 11:37:59 AM

Sample Information:

Lab ID: 25010675-73 Client Sample ID: 24-165G.73  
Collection Date: 1/16/2025 6:05:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Juniper Hall L Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

Lab ID: 25010675-74 Client Sample ID: 24-165G.74  
Collection Date: 1/16/2025 6:05:00 AM Collected By: Darrell Walker  
Matrix: Drinking Water Sample Location: Juniper Hall R Drinking Ftn

Trace Metals by EPA 200.8 ICP-MS							Analyst: KN	
Analyses	Result	Qual	MRL	Units	DF	Date Analyzed	MCL	NELAP Status
Lead	ND		0.500	ppb	1	1/24/2025	15.0	A

QUALIFIERS	*	Value exceeds Maximum or Minimum Contaminant Level.	C1	Sample container temperature is out of limit as specified at testcod
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	MI	Recovery outside control limits due to Matrix Interference
	ND	Not Detected at the Reporting Limit	PL	Permit Limit
	PRE	Percent RE exceeds the Limit	R	RPD outside accepted recovery limits

NELAP A Accredited in accordance with NELAP ORELAP 100016, OR-028

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## QC SUMMARY REPORT

WO#: 25010675  
28-Jan-25

Client: Coleman Creek Consulting  
Project: 24-165G Henley ES

TestCode: LEAD\_DW

Sample ID: <b>MB-29973</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/22/2025</b>	RunNo: <b>55669</b>						
Client ID: <b>PBW</b>	Batch ID: <b>29973</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/22/2025</b>	SeqNo: <b>920144</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	ND	0.500									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: <b>LCS-29973</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/22/2025</b>	RunNo: <b>55669</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>29973</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/22/2025</b>	SeqNo: <b>920145</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	99.2	0.500	100	0	99.2	85	115				
------	------	-------	-----	---	------	----	-----	--	--	--	--

Sample ID: <b>25010669-67AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/22/2025</b>	RunNo: <b>55669</b>						
Client ID: <b>BatchQC</b>	Batch ID: <b>29973</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/22/2025</b>	SeqNo: <b>920147</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	95.6	0.500	100	1.50	94.1	70	130				
------	------	-------	-----	------	------	----	-----	--	--	--	--

Sample ID: <b>25010669-67AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/22/2025</b>	RunNo: <b>55669</b>						
Client ID: <b>BatchQC</b>	Batch ID: <b>29973</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/22/2025</b>	SeqNo: <b>920148</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	98.2	0.500	100	1.50	96.7	70	130	95.6	2.64	20	
------	------	-------	-----	------	------	----	-----	------	------	----	--

Qualifiers:	C1	Sample container temperature is out of limit as specified at testcode	H	Holding times for preparation or analysis exceeded	MI	Recovery outside control limits due to Matrix In
	ND	Not Detected at the Reporting Limit	PL	Permit Limit	RL	Reporting Detection Limit

Original





Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## QC SUMMARY REPORT

WO#: 25010675  
28-Jan-25

Client: Coleman Creek Consulting  
Project: 24-165G Henley ES

TestCode: LEAD\_DW

Sample ID: <b>MB-29982</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>						
Client ID: <b>PBW</b>	Batch ID: <b>29982</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920400</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	ND	0.500									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: <b>LCS-29982</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>29982</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920401</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	101	0.500	100	0	101	85	115				
------	-----	-------	-----	---	-----	----	-----	--	--	--	--

Sample ID: <b>25010787-01AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>						
Client ID: <b>BatchQC</b>	Batch ID: <b>29982</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920403</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	99.3	0.500	100	0.875	98.4	70	130				
------	------	-------	-----	-------	------	----	-----	--	--	--	--

Sample ID: <b>25010787-01AMSD</b>	SampType: <b>MSD</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>						
Client ID: <b>BatchQC</b>	Batch ID: <b>29982</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920404</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual


Lead	101	0.500	100	0.875	100	70	130	99.3	1.96	20	
------	-----	-------	-----	-------	-----	----	-----	------	------	----	--

Qualifiers: C1 Sample container temperature is out of limit as specified at testcode  
ND Not Detected at the Reporting Limit

H Holding times for preparation or analysis exceeded  
PL Permit Limit

MI Recovery outside control limits due to Matrix In  
RL Reporting Detection Limit

Original

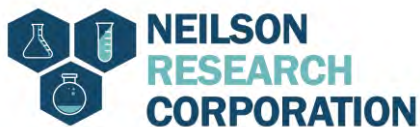

Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## QC SUMMARY REPORT

WO#: 25010675  
28-Jan-25

**Client:** Coleman Creek Consulting  
**Project:** 24-165G Henley ES

**TestCode:** LEAD\_DW

Sample ID: <b>MB-29983</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>
Client ID: <b>PBW</b>	Batch ID: <b>29983</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920417</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.500

Sample ID: <b>MB-29983</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>
Client ID: <b>PBW</b>	Batch ID: <b>29983</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920418</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead ND 0.500

Sample ID: <b>LCS-29983</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>
Client ID: <b>LCSW</b>	Batch ID: <b>29983</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920419</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 102 0.500 100 0 102 85 115

Sample ID: <b>LCS-29983</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/23/2025</b>	RunNo: <b>55689</b>
Client ID: <b>LCSW</b>	Batch ID: <b>29983</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/23/2025</b>	SeqNo: <b>920420</b>
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC LowLimit HighLimit RPD Ref Val %RPD RPDLimit Qual

Lead 102 0.500 100 0 102 85 115

**Qualifiers:** C1 Sample container temperature is out of limit as specified at testcode  
ND Not Detected at the Reporting Limit  
H Holding times for preparation or analysis exceeded  
PL Permit Limit  
MI Recovery outside control limits due to Matrix In  
RL Reporting Detection Limit

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## QC SUMMARY REPORT

WO#: 25010675  
28-Jan-25

Client: Coleman Creek Consulting  
Project: 24-165G Henley ES

TestCode: LEAD\_DW

Sample ID: 25010675-27AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 1/23/2025	RunNo: 55689						
Client ID: 24-165G.27	Batch ID: 29983	TestNo: E200.8	E200.8	Analysis Date: 1/23/2025	SeqNo: 920422						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	99.7	0.500	100	0.143	99.6	70	130				
------	------	-------	-----	-------	------	----	-----	--	--	--	--

Sample ID: 25010675-27AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 1/23/2025	RunNo: 55689						
Client ID: 24-165G.27	Batch ID: 29983	TestNo: E200.8	E200.8	Analysis Date: 1/23/2025	SeqNo: 920423						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	99.5	0.500	100	0.143	99.4	70	130	99.7	0.207	20	
------	------	-------	-----	-------	------	----	-----	------	-------	----	--

Sample ID: <b>MB-30008</b>	SampType: <b>MBLK</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/24/2025</b>	RunNo: <b>55735</b>						
Client ID: <b>PBW</b>	Batch ID: <b>30008</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/24/2025</b>	SeqNo: <b>921026</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	ND	0.500									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: <b>LCS-30008</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/24/2025</b>	RunNo: <b>55735</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>30008</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/24/2025</b>	SeqNo: <b>921027</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	99.8	0.500	100	0	99.8	85	115				
------	------	-------	-----	---	------	----	-----	--	--	--	--

Qualifiers: C1 Sample container temperature is out of limit as specified at testcode  
ND Not Detected at the Reporting Limit

H Holding times for preparation or analysis exceeded  
PL Permit Limit

MI Recovery outside control limits due to Matrix In  
RL Reporting Detection Limit

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## QC SUMMARY REPORT

WO#: 25010675  
28-Jan-25

Client: Coleman Creek Consulting  
Project: 24-165G Henley ES

TestCode: LEAD\_DW

Sample ID: <b>25010871-01AMS</b>	SampType: <b>MS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/24/2025</b>	RunNo: <b>55735</b>						
Client ID: <b>BatchQC</b>	Batch ID: <b>30008</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/24/2025</b>	SeqNo: <b>921029</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	97.6	0.500	100	0.104	97.5	70	130				
------	------	-------	-----	-------	------	----	-----	--	--	--	--

Sample ID: 25010871-01AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 1/24/2025	RunNo: 55735						
Client ID: BatchQC	Batch ID: 30008	TestNo: E200.8	E200.8	Analysis Date: 1/24/2025	SeqNo: 921030						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	96.4	0.500	100	0.104	96.3	70	130	97.6	1.20	20	
------	------	-------	-----	-------	------	----	-----	------	------	----	--

Sample ID: MB-30009	SampType: MBLK	TestCode: LEAD_DW	Units: ppb	Prep Date: 1/24/2025	RunNo: 55735						
Client ID: PBW	Batch ID: 30009	TestNo: E200.8	E200.8	Analysis Date: 1/24/2025	SeqNo: 921049						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	ND	0.500									
------	----	-------	--	--	--	--	--	--	--	--	--

Sample ID: <b>LCS-30009</b>	SampType: <b>LCS</b>	TestCode: <b>LEAD_DW</b>	Units: <b>ppb</b>	Prep Date: <b>1/24/2025</b>	RunNo: <b>55735</b>						
Client ID: <b>LCSW</b>	Batch ID: <b>30009</b>	TestNo: <b>E200.8</b>	<b>E200.8</b>	Analysis Date: <b>1/24/2025</b>	SeqNo: <b>921050</b>						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Lead	102	0.500	100	0	102	85	115				
------	-----	-------	-----	---	-----	----	-----	--	--	--	--

Qualifiers:	C1	Sample container temperature is out of limit as specified at testcode	H	Holding times for preparation or analysis exceeded	MI	Recovery outside control limits due to Matrix In
	ND	Not Detected at the Reporting Limit	PL	Permit Limit	RL	Reporting Detection Limit

Original



Neilson Research Corporation  
245 S Grape St  
Medford, OR 97501  
TEL: (541) 770-5678 FAX: (541) 770-2901  
Website: www.nrclabs.com

## QC SUMMARY REPORT

WO#: 25010675  
28-Jan-25

Client: Coleman Creek Consulting  
Project: 24-165G Henley ES

TestCode: LEAD\_DW

Sample ID: 25010675-60AMS	SampType: MS	TestCode: LEAD_DW	Units: ppb	Prep Date: 1/24/2025	RunNo: 55735						
Client ID: 24-165G.60	Batch ID: 30009	TestNo: E200.8	E200.8	Analysis Date: 1/24/2025	SeqNo: 921052						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	96.7	0.500	100	0.0860	96.6	70	130				

Sample ID: 25010675-60AMSD	SampType: MSD	TestCode: LEAD_DW	Units: ppb	Prep Date: 1/24/2025	RunNo: 55735						
Client ID: 24-165G.60	Batch ID: 30009	TestNo: E200.8	E200.8	Analysis Date: 1/24/2025	SeqNo: 921053						
Analyte	Result	PQL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	95.3	0.500	100	0.0860	95.2	70	130	96.7	1.40	20	

Qualifiers: C1 Sample container temperature is out of limit as specified at testcode  
ND Not Detected at the Reporting Limit  
H Holding times for preparation or analysis exceeded  
PL Permit Limit  
MI Recovery outside control limits due to Matrix In  
RL Reporting Detection Limit

Original

## Sample Log-In Check List

Client Name: **ColemanCreek**

Work Order Number: **25010675**

RcptNo: **1**

Logged by: **Ashley Spiegelberg** **1/16/2025 2:54:00 PM**

Completed By: **Danielle Garten** **1/20/2025 9:13:46 AM**

Reviewed By: **Ashley Spiegelberg** **1/28/2025 11:13:47 AM**

*Am*  
*Danielle Garten*  
*Am*

### Chain of Custody

1. Is Chain of Custody complete? Yes ☒ No ☐ Not Present ☐  
2. How was the sample delivered? Client

### Log In

3. Coolers are present? Yes ☐ No ☐ NA ☒  
4. Shipping container/cooler in good condition? Yes ☒ No ☐  
Custody seals intact on shipping container/cooler? Yes ☐ No ☐ Not Present ☒ NA ☐  
No. Seal Date: Signed By:  
5. Was an attempt made to cool the samples? Yes ☐ No ☐ NA ☒  
6. Were all samples received at a temperature of >0° C to 6.0°C Yes ☐ No ☐ NA ☒  
7. Sample(s) in proper container(s)? Yes ☒ No ☐  
8. Sufficient sample volume for indicated test(s)? Yes ☒ No ☐  
9. Are samples (except VOA and ONG) properly preserved? Yes ☒ No ☐  
10. Was preservative added to bottles? Yes ☒ No ☐ NA ☐  
11. Is the headspace in the VOA vials less than 1/4 inch or 6 mm? Yes ☐ No ☐ HNO3 pH<2  
No VOA Vials ☒  
12. Were any sample containers received broken? Yes ☐ No ☒  
13. Does paperwork match bottle labels? Yes ☒ No ☐  
(Note discrepancies on chain of custody)  
14. Are matrices correctly identified on Chain of Custody? Yes ☒ No ☐  
15. Is it clear what analyses were requested? Yes ☒ No ☐  
16. Were all holding times able to be met? Yes ☒ No ☐  
(If no, notify customer for authorization.)

### Special Handling (if applicable)

17. Was client notified of all discrepancies with this order? Yes ☐ No ☐ NA ☒

Person Notified:  Date:   
By Whom:  Via: ☐ eMail ☐ Phone ☐ Fax ☐ In Person  
Regarding:   
Client Instructions:

18. Additional remarks:

### Cooler Information

Cooler No	Temp °C	Condition	Seal Intact	Seal No	Seal Date	Signed By
-----------	---------	-----------	-------------	---------	-----------	-----------



# Chain of Custody Record

This Chain of Custody is a LEGAL DOCUMENT and must be filled out accurately.

## Section A

### Required Client Information

Company:	Coleman Creek Consulting
Address:	810 Leonard St Ashland, OR 97520
Email:	<a href="mailto:fawbro@ccountry.net">fawbro@ccountry.net</a>
Phone:	Fax:
Collected By (Print):	Darrell Walker
Collected By (Sign):	
Email Report <input type="checkbox"/>	Mail Report <input type="checkbox"/> Fax Report <input type="checkbox"/>

## Section B

### Required Project Information

Project Name:	Henley ES
Project Number:	24-165G
Report To:	Dave Fawcett
Copy To:	

## Section C

### Invoice Information

Attention:	
Company Name:	
Address:	
P.O. #	

## Section D

### Rush Status (Subject to Scheduling)

<input checked="" type="checkbox"/> Standard: 10 Business Days
<input type="checkbox"/> Priority: 5 Business Days (List x 1.50)
<input type="checkbox"/> Express: 3 Business Days (List x 1.75)
<input type="checkbox"/> Rush: 2 Business Days (List x 2.00)
<input type="checkbox"/> Rush: 1 Business Day (List x 2.50)
<input type="checkbox"/> Rush: Same Day (List x 3.00)
Authorized <input type="checkbox"/> Yes <input type="checkbox"/> No

## Section E

### Sample Information

Sample ID	Comp/Grab	Matrix*	Date Collected	Time Collected	No. of Containers	Analysis Requested										NRC Workorder # (Lab Use Only)	Remarks / Field Data	NRC Sample # Use Only)	(Lab
24-165G, 1-74	Grab	DW	1-16-25	see below	74	Total Pb										25010675		01-74	

\*Matrix: DW - Drinking Water WW - Wastewater W - Water S - Soil/Solid SL - Sludge O - Oil WP - Wipe OT - Other

## Section F

### Relinquish/Receive


Relinquished By:	Sign	Print	Date	Time
Received By:				
Relinquished By:				
Received By:				
Relinquished By:				
Received By Laboratory:				

## Section G

### Lab Use Only

Temp:	IR Therm ID:
≤6°C: <input type="checkbox"/> Yes <input type="checkbox"/> No	
Received on Ice: <input type="checkbox"/> Yes <input type="checkbox"/> No	
Number of Bottles Received:	
pH Checked:	
COC Seals Intact: <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	
Field Blank Included: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
Received Via <input type="checkbox"/> UPS <input type="checkbox"/> FedEx <input type="checkbox"/> Other <input checked="" type="checkbox"/> Hand	

Payment: <input checked="" type="checkbox"/> Invoice <input type="checkbox"/> Cash <input type="checkbox"/> VISA, M/C <input type="checkbox"/> Check # <input type="checkbox"/> Amount <input type="checkbox"/>
---



# Coleman Creek Consulting, Inc.

DAVE 944-5318

REC#: 25010675

## DRINKING WATER SITE SAMPLE RECORD SHEET


BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME
01	24-165G.1	DW	Kitchen Right Handwash Sink Faucet	4:57
02	24-165G.2	DW	Kitchen Middle Handwash Sink Faucet	4:57
03	24-165G.3	DW	Kitchen Restroom Sink Faucet	4:58
04	24-165G.4	DW	Kitchen Right Handwash Sink Faucet	4:59
05	24-165G.5	DW	Kitchen Sink Faucet	5:01
06	24-165G.6	DW	Kitchen Pot Filler Sink Faucet	5:02
07	24-165G.7	DW	Room P116 Sink	5:04
08	24-165G.8	DW	Cafeteria Bottle Fill Fountain	5:06
09	24-165G.9	DW	Cafeteria Drinking Fountain	5:07
10	24-165G.10	DW	Gym Hall Left Drinking Fountain	5:07
11	24-165G.11	DW	Gym Hall Right Drinking Fountain	5:08
12	24-165G.12	DW	Girl's Bath at Gym Left Sink Faucet	5:09
13	24-165G.13	DW	Girl's Bath at Gym Left Middle Sink Faucet	5:09
14	24-165G.14	DW	Girl's Bath at Gym Right Middle Sink Faucet	5:10
15	24-165G.15	DW	Girl's Bath at Gym Right Sink Faucet	5:10
16	24-165G.16	DW	Boy's Bath at Gym Left Sink Faucet	5:11
17	24-165G.17	DW	Boy's Bath at Gym Left Middle Sink Faucet	5:11
18	24-165G.18	DW	Boy's Bath at Gym Right Middle Sink Faucet	5:12
19	24-165G.19	DW	Boy's Bath at Gym Right Sink Faucet	5:12
20	24-165G.20	DW	Family Restroom Sink Faucet	5:14

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle





# Coleman Creek Consulting, Inc.

NEC#: 75010675


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME
21	24-165G.21	DW	Aspen Hall Left Drinking Fountain	5:17
22	24-165G.22	DW	Aspen Hall Right Drinking Fountain	5:17
23	24-165G.23	DW	Aspen Boy's Bath Left Sink Faucet	5:23
24	24-165G.24	DW	Aspen Boy's Bath Left Middle Sink Faucet	5:23
25	24-165G.25	DW	Aspen Boy's Bath Right Middle Sink Faucet	5:25
26	24-165G.26	DW	Aspen Boy's Bath Right Sink Faucet	5:25
27	24-165G.27	DW	Aspen Girl's Bath Left Sink Faucet	5:26
28	24-165G.28	DW	Aspen Girl's Bath Left Middle Sink Faucet	5:26
29	24-165G.29	DW	Aspen Girl's Bath Right Middle Sink Faucet	5:28
30	24-165G.30	DW	Aspen Girl's Bath Right Sink Faucet	5:28
31	24-165G.31	DW	Room 106A Sink Faucet	5:32
32	24-165G.32	DW	Room 105A Sink Faucet	5:36
33	24-165G.33	DW	Room 104A Sink Faucet	5:37
34	24-165G.34	DW	Room 103A Sink Faucet	5:38
35	24-165G.35	DW	Room 102A Sink Faucet	5:41
36	24-165G.36	DW	Room 101A Sink Faucet	5:42
37	24-165G.37	DW	Room 100A Sink Faucet	5:43
38	24-165G.38	DW	Aspen Staff Restroom Sink Faucet	5:45
39	24-165G.39	DW	Speech Room Sink Faucet	5:47
40	24-165G.40	DW	ELL Room Sink Faucet	5:48

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.

REC#: 25010675

Dave 944-5318


## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME
41	24-165G.41	DW	Staff Lounge Sink Faucet	5:35
42	24-165G.42	DW	Staff Right Bath Sink Faucet	5:37
43	24-165G.43	DW	Staff Left Bath Sink Faucet	5:39
44	24-165G.44	DW	Nurse Office Bath Sink Faucet	5:41
45	24-165G.45	DW	Norse Office Sink Faucet	5:43
46	24-165G.46	DW	Room W108 Kinder Bath Sink Faucet	5:45
47	24-165G.47	DW	Room W108 Sink Faucet	5:47
48	24-165G.48	DW	Room W107 Sink Faucet	5:49
49	24-165G.49	DW	Room W107 Kinder Bath Sink Faucet	5:51
50	24-165G.50	DW	Room J100 Sink Faucet	5:52
51	24-165G.51	DW	Room J100 Kinder Bath Sink Faucet	5:53
52	24-165G.52	DW	Room J101 Sink Faucet	5:55
53	24-165G.53	DW	Room J102 Sink Faucet	5:56
54	24-165G.54	DW	Room J103 Sink Faucet	5:58
55	24-165G.55	DW	Room J104 Sink Faucet	6:00
56	24-165G.56	DW	Room J105 Sink Faucet	6:02
57	24-165G.57	DW	Room J106 Sink Faucet	6:02
58	24-165G.58	DW	Willow Boy's Bath Left Sink Faucet	6:03
59	24-165G.59	DW	Willow Boy's Bath Left Middle Sink Faucet	6:04
60	24-165G.60	DW	Willow Boy's Bath Right Middle Sink Faucet	6:05

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle



# Coleman Creek Consulting, Inc.

NR1#: 25010675

## DRINKING WATER SITE SAMPLE RECORD SHEET

BUILDING: Henley Elementary School  
ADDRESS: 8245 Hwy. 39  
Klamath Falls, Oregon

DATE: 01-16-25  
SAMPLER: Darrell Walker

	SAMPLE #	SAMPLE TYPE	LOCATION	TIME
61	24-165G.61	DW	Willow Boy's Bath Right Sink Faucet	6:06
62	24-165G.62	DW	Willow Girl's Bath Left Sink Faucet	6:07
63	24-165G.63	DW	Willow Girl's Bath Left Middle Sink Faucet	6:08
64	24-165G.64	DW	Willow Girl's Bath Right Middle Sink Faucet	6:09
65	24-165G.65	DW	Willow Girl's Bath Right Sink Faucet	6:09
66	24-165G.66	DW	Willow Staff Bath Sink Faucet	6:03
67	24-165G.67	DW	Room W100 Sink Faucet	6:08
68	24-165G.68	DW	Room W101 Sink Faucet	6:08
69	24-165G.69	DW	Room W102 Sink Faucet	6:10
70	24-165G.70	DW	Room W103 Sink Faucet	6:11
71	24-165G.71	DW	Room W104 Sink Faucet	6:12
72	24-165G.72	DW	Room W105 Sink Faucet	6:13
73	24-165G.73	DW	Juniper Hall Left Drinking Fountain	6:05
74	24-165G.74	DW	Juniper Hall Right Drinking Fountain	6:05

Comments: DW = Drinking Water RR = Restroom R = Right L = Left RM = Right Middle  
LM = Left Middle M = Middle